

EPA1500 / Cx Monitor With Clamp CT's



monitoring services

**INSTALLATION
INSTRUCTIONS OF THE
POWER ANALYZER****WARNING-WARNING-WARNING**

Read and understand this manual before connecting device.

Death, fire or serious injury can occur from using equipment outside of safety ratings or improper use.

Installation must be performed from qualified personnel only. Follow applicable safety work practices, including using the proper personal protective equipment during install.

**ALWAYS POWER DOWN ALL
ELECTRICAL CIRCUITS BEFORE
INSTALLATION**

**SYSTEM MUST BE POWERED FROM GROUNDED RECEPTACLE.
THESE STEPS REQUIRE SYSTEM-TRAINED OR LOCAL QUALIFIED
PERSONNEL ONLY!**

Rev06

June 04, 2023

1



©2013 Rx Monitoring Services, Inc.

THIS INFORMATION IS PROPERTY OF
RX MONITORING SERVICE, INC • 1 SUNDIAL AVE STE 117N MANCHESTER, NH 03103
TELEPHONE: (603) 666-6606 • EMAIL: SUPPORT@RXMS.COM • WEB: WWW.RXMS.COM



Specifications are subject to change without notice.

Definitions:

- **WARNING**
This statement is to reinforce the practice of certain conditions may cause physical bodily harm or loss of life.
- **CAUTION**
This statement is to reinforce the practice of certain conditions may cause physical damage to the Cx Monitor, accessories, equipment or property.

SYMBOLS:

THE FOLLOWING ARE (IEC) SYMBOLS ARE USED ON THIS DOCUMENT OR ON THE POWER MONITOR, AND THEIR DEFINITIONS.



This symbol indicates AC or DC voltage or current



This symbol indicates safety ground conductor.



This symbol indicates high voltage. It calls your attention to items or operations that could be dangerous to you and other persons operating this equipment.
Read the message and follow the instructions carefully.



This symbol indicates that caution is necessary when operating the device or control close to where the symbol is placed, or to indicate that the current situation needs operator awareness or operator action in order to avoid undesirable consequences.



WARNING:



- Before using the power monitor inspect wireless probes, voltage probes, current probes, leads and accessories for mechanical damage or broken plastic and call Rx Monitoring Services Inc. for replacements.
- Wear proper Personal Protective Equipment, including safety glasses and insulated gloves when making connections to power circuits.
- Use only current probes, test leads, and adapters supplied with the power monitor and wireless probes.
- Remove unnecessary voltage leads or accessories that are not in use.
- Make sure the power monitor is properly connected through the power cord to protective earth ground.
- Do not insert foreign objects into connectors, only use approved accessories.
- Never open the power monitor, there are no customer replaceable parts.
- Never use power monitor outside or when condensing water is present.
- Use supplied safety kit and properly lockout circuits under test.
- Hands, boots and the working area must be dry when making connections to power system.
- Do not operate the Power Monitor or probes around volatile gas or vapor.

******* WARNING DO NOT EXCEED SAFETY RATINGS *******

Power Monitor	: CAT III - 600V	Pollution Degree 2
Rope CT's	: CAT III - 1000V	Pollution Degree 2
Clamp CT's	: CAT III - 600V	Pollution Degree 2
Wireless DC	: CAT II - 600V	Pollution Degree 2
Wireless DCx	: CAT II - 150V	Pollution Degree 2



Quick Reference Guide for the Power Monitor:

Please refer to the Installation Instructions for full details on how to install the Power Monitor. (Attached)




Follow these simple steps:

1. Unpack the Power Monitor
2. Power down load and turn off the power at the main circuit breaker
3. Connect the Alligator or Strip Voltage Leads
4. Connect the Current Probes
5. Connect the Temp/Hum Probe
6. Power up the Power Monitor
7. Power up Load Circuit and System
8. Fill out Site Info and Detailed Site Log
9. Let the system run for approximately a week and then remove the Power Monitor.



WARNING! HIGH VOLTAGE!

**The above steps require system-trained personnel or local qualified personnel only.
(i.e. a local electrician)**

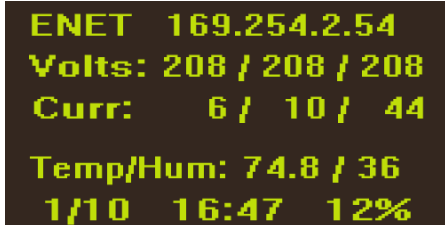

Example display for three phase power.

Site Information 04-Jun-23

Please call us at (603) 666-6000 **40** before installing the power monitor and reference the following Site Registration #

Site Registration #:

Please return all equipment by:

Installer Information	
Name/Company:	
Phone #:	Email:
Additional Emails:	
Customer Information	
Name/Company (if Different):	
Phone #:	Email:
Your Equipment Information	
Cust Code/Eq. Serial #:	Type of Eq.:
Date/Time of Monitor Installation:	System Voltage:
What Leads Were Plugged into the Monitor?:	<input type="checkbox"/> L1 <input type="checkbox"/> L2 <input type="checkbox"/> L3 <input type="checkbox"/> Neutral <input type="checkbox"/> Ground
Power Source You Are Monitoring?:	<input type="checkbox"/> Inlet/Wall Connection <input type="checkbox"/> OIR <input type="checkbox"/> Output of Power Protection
Power Protection Brand/Model (if used):	
Reason for Monitoring (New Install / Outstanding Issues - Please Describe):	

Please use the Detailed Site Log to track any System Errors, Resets, Site Issues, etc.

Rx Monitoring Services, Inc. | 1 SUNDIAL AVE STE 117 MANCHESTER, NH 03103
Telephone: (603) 666-6000 | Support: Ext. 9 | WEB: www.rxms.com

Detailed Site Log 04-Jun-23

Please call us at (603) 666-6000 **40** before installing the power monitor and reference the following Site Registration #

Site Registration #:

Site Name:		Your Name:	
Equipment ID/Serial #:		Your Email:	
Date	Time	Event - Equipment Power Up/Down, Environmental Conditions, Errors, Etc.	
Comments:			

Please fill out this log and return with monitor or fax to: 603-666-0009
Rx Monitoring Services, Inc. | 1 SUNDIAL AVE STE 117 MANCHESTER, NH 03103
Telephone: (603) 666-6000 | Support: Ext. 9 | Web: www.rxms.com

1. Unpack the Power Monitor



Power Monitor

- a. Check the packing list to make sure all of the requested equipment was received.
- b. Position near the connection point to be tested (be sure the Power Monitor is positioned in an area where it will not be dropped or interfered with).
- c. Be sure a 120V-240V receptacle is available for powering the device.

2. Power down system and turn off the power at the main breaker



- a. To ensure safe working conditions make sure to remove voltage from testing source. (Lockout if required)



3. Connect the Voltage Leads:



Connect Voltage Leads

- a. Confirm that the system under test is powered down and that power at the main circuit breaker is off.
- b. Connect the L1, L2 and L3 voltage leads (alligator clip or strip) to the main circuit breaker. Connect the N lead to the Neutral bar (if present), and the G lead to the main chassis or the Ground bar.
- c. Connect the right-angle banana plug end of the voltage leads into their corresponding color-coded ports on the front panel of the Power Monitor.



Connect Banana Leads



Caution: If running Voltage leads out of the panel or system, wrap the “Safety Sleeves” provided in the safety kit around wires at pinch points.


4. Connect the Current Probes

Hard wired connection




Caution: If running the CT wires out of the panel or system, wrap the “Safety Sleeves” provided in the safety kit around wires at pinch points.

- a. Please note that connecting the current probes is a crucial part of the data gathering process. Please make sure you connect them to ensure that all supporting data is gathered.
- b. Connect the current probes around L1, L2, L3, N & G (or all applicable phases) and make sure that there is only one phase in each current probe.
- c. Make sure that each current probe is encompassing the correct phase and that the direction of the arrow on the probe is pointing toward the load.
- d. Plug the connector end of the current probes into their corresponding ports on the front of the Power Monitor (to the right of the color-coded voltage ports).

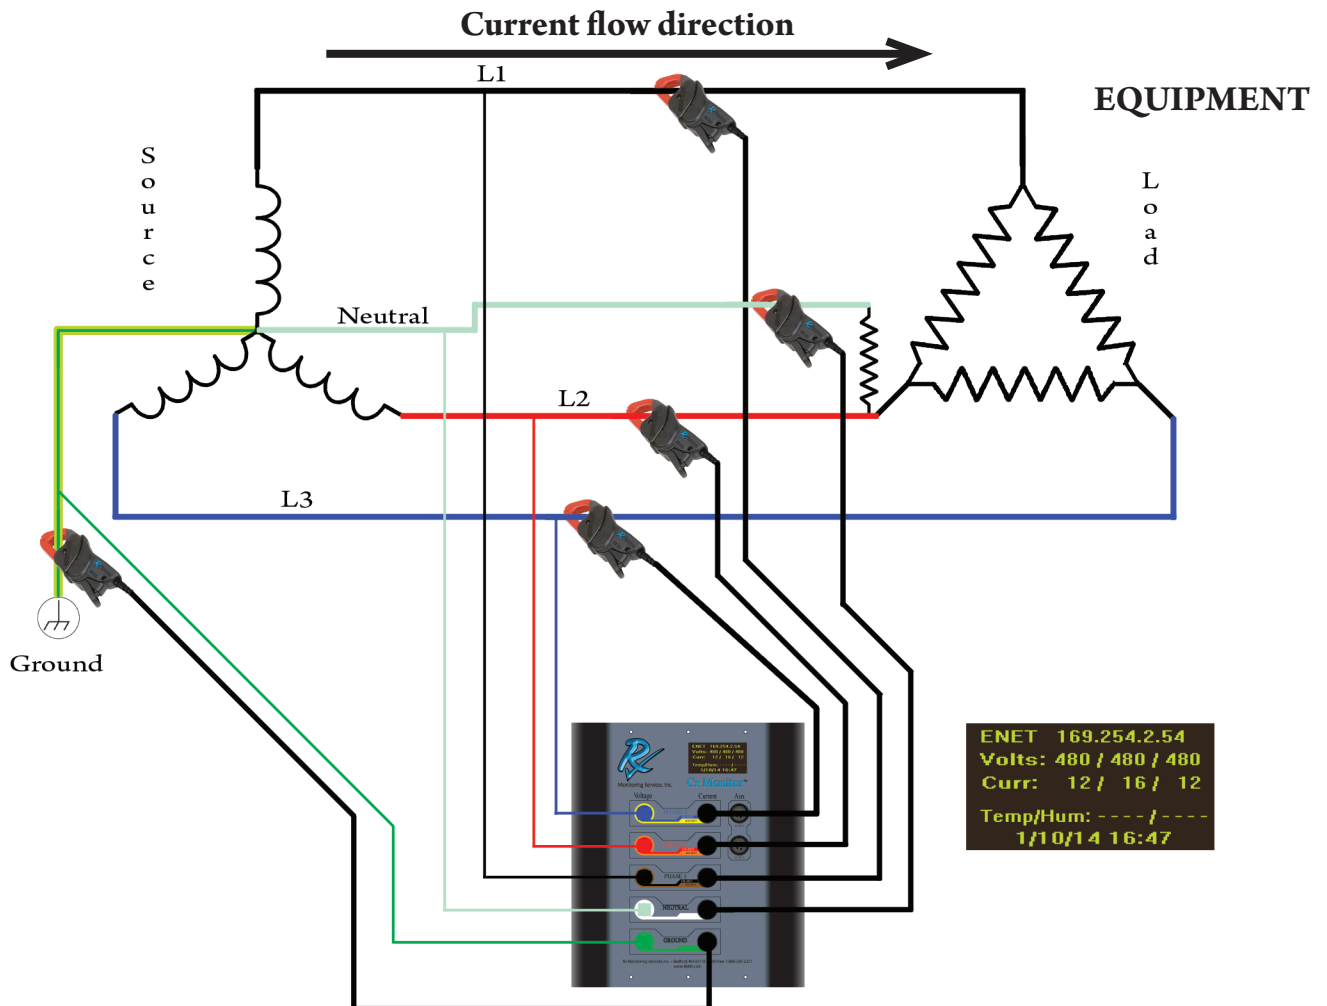

“Breakout” cable connections

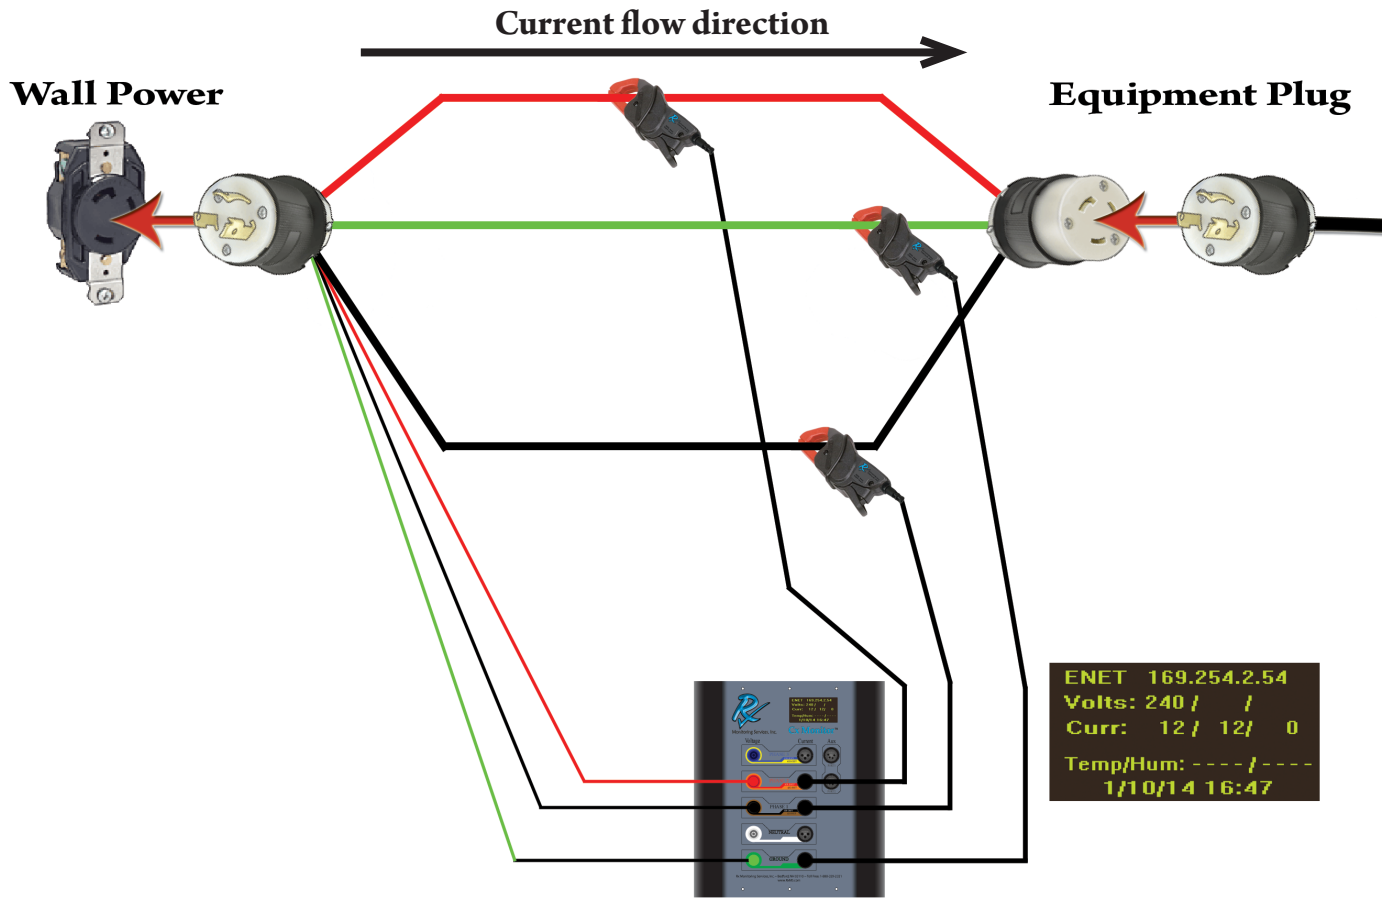

Important:

Arrow on CT's must point toward load being monitored,
or the direction of current flow.



5. Connect the Temperature & Humidity Probe (If Supplied)



- a. Hang the Temp/Hum probe at a minimum height of 6 feet (if possible), and make sure it is not positioned near a door, window, or ventilation unit.
- b. Plug into the Port 1 under AUX on the front of the Power Monitor.

6. Power up the Cx Monitor




Caution - Always use a grounded receptacle



- a. Plug power cord into grounded receptacle
- b. Plug the supplied IEC cord into the external DC power supply.
- c. Plug the male external DC power supply plug into the Power Monitor.



DC Power Supply

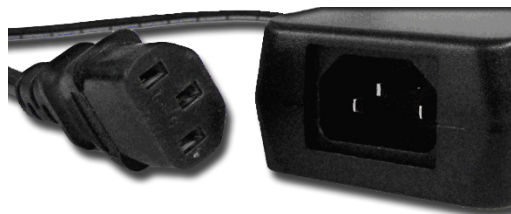


b. Connect IEC



c. Plug In Barrel

7. Power up load circuit and system

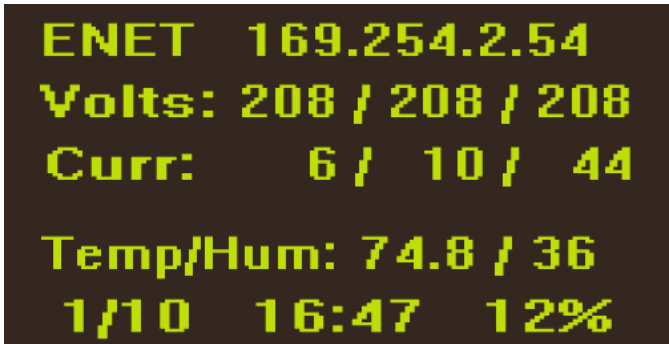

Sample Reading

The LCD screen will illuminate when the Power Monitor is on. In about 30 seconds, the LCD screen will show real-time, voltage, current and temperature / humidity readings as well as the Date/Time the monitor is set to and the percent of storage used.

LCD screen will display...

Volts: ### / / For single phase with black lead connected only.

Volts: ### / / For single phase two pole with black and red leads connected.

Volts: ### / ### / ### For 3 phase with black, red, and blue leads connected

8. Fill out Site Info and Detailed Site Log

Site Information Sheet

- a. Please make sure you fully complete the RxMS Site Information sheet with the detailed information of the site and equipment being monitored.
- b. Make sure you leave the Detailed Site Log that was provided with the Power Monitor with your customer. Ask them to record any system events or errors that will help RxMS correlate gathered data to any issues you may be having with your system.

Detailed Site Log

- c. Place the “Electrical Test In Progress” tag on the system under test (either on the main disconnect, panel or wires) so it is not disturbed during the monitoring period.
- d. Please contact RxMS at 603-666-6606 ext. 0 or email support@rxms.com once you have installed the Power Monitor.

9. Uninstall the Power Monitor and ship back to RxMS



Shipping Return Label

- a. Power down load and the main power.
- b. Unplug the power cord from the Power Monitor.
- c. Disconnect all probes from the Power Monitor.
- d. Pack all equipment in provided shipping case.
- e. Attach the enclosed return label and ship equipment back to RxMS.
- f. Please contact RxMS at 603-666-6606 ext. 0 or email support@rxms.com once you have dropped off or FedEx has picked up the Power Monitor.

EPA1500 / Cx Monitor With Clamp CT's

STATEMENTS, NOTICES AND LIABILITY INFORMATION

FCC Part 15 Class B

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against interference in a residential installation.

This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation.

If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the affected equipment and the panel receiver to separate outlets, on different branch circuits.
- Consult the dealer or an experienced radio/TV technician for help.

STATEMENT OF FAULTLESSNESS:

The information in this manual has been reviewed for accuracy at the time of writing. No responsibility can be assumed by Rx Monitoring Services Inc. for inaccuracy or changes that have taken place since production. The "Cx Monitor Installation Manual" is for informational purposes only and is subject to change without notice.

LIABILITY:

RXMS SHALL NOT BE LIABLE FOR ANY (A) SPECIAL, INDIRECT, INCIDENTAL, PUNITIVE, OR CONSEQUENTIAL DAMAGES, INCLUDING LOSS OF PROFITS, ARISING FROM OR RELATED TO A BREACH OF THIS AGREEMENT OR ANY ORDER OR THE OPERATION OR USE OF THE MONITORING EQUIPMENT INCLUDING SUCH DAMAGES, WITHOUT LIMITATION, AS DAMAGES ARISING FROM LOSS OF DATA OR PROGRAMMING, LOSS OF REVENUE OR PROFITS, FAILURE TO REALIZE SAVINGS OR OTHER BENEFITS, DAMAGE TO EQUIPMENT, AND CLAIMS AGAINST CUSTOMER BY ANY THIRD PERSON, EVEN IF RXMS HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES; (B) DAMAGES (REGARDLESS OF THEIR NATURE) FOR ANY DELAY OR FAILURE BY RXMS TO PERFORM ITS OBLIGATIONS UNDER THIS AGREEMENT DUE TO ANY CAUSE BEYOND RXMS'S REASONABLE CONTROL; OR (C) CLAIMS MADE A SUBJECT OF A LEGAL PROCEEDING AGAINST RXMS MORE THAN TWO YEARS AFTER ANY SUCH CAUSE OF ACTION FIRST AROSE.

COPYRIGHT:

© 2013, Rx Monitoring Services Inc.

ALL RIGHTS RESERVED. This document contains material protected under International and Federal Copyright Laws and Treaties. Any unauthorized reprint or use of this material is prohibited. No part of this manual may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system without express written permission from Rx Monitoring Services Inc.

June 04, 2023

10



©2013 Rx Monitoring Services, Inc.

THIS INFORMATION IS PROPERTY OF
RX MONITORING SERVICE, INC • 1 SUNDIAL AVE STE 117N MANCHESTER, NH 03103
TELEPHONE: (603) 666-6606 • EMAIL: SUPPORT@RXMS.COM • WEB: WWW.RXMS.COM



Specifications are subject to change without notice.